


THE SHIELD CONNECTOR SHOULD BE ATTACHED TO THE GND TERMINAL ON THE RS485-2 CONNECTOR.

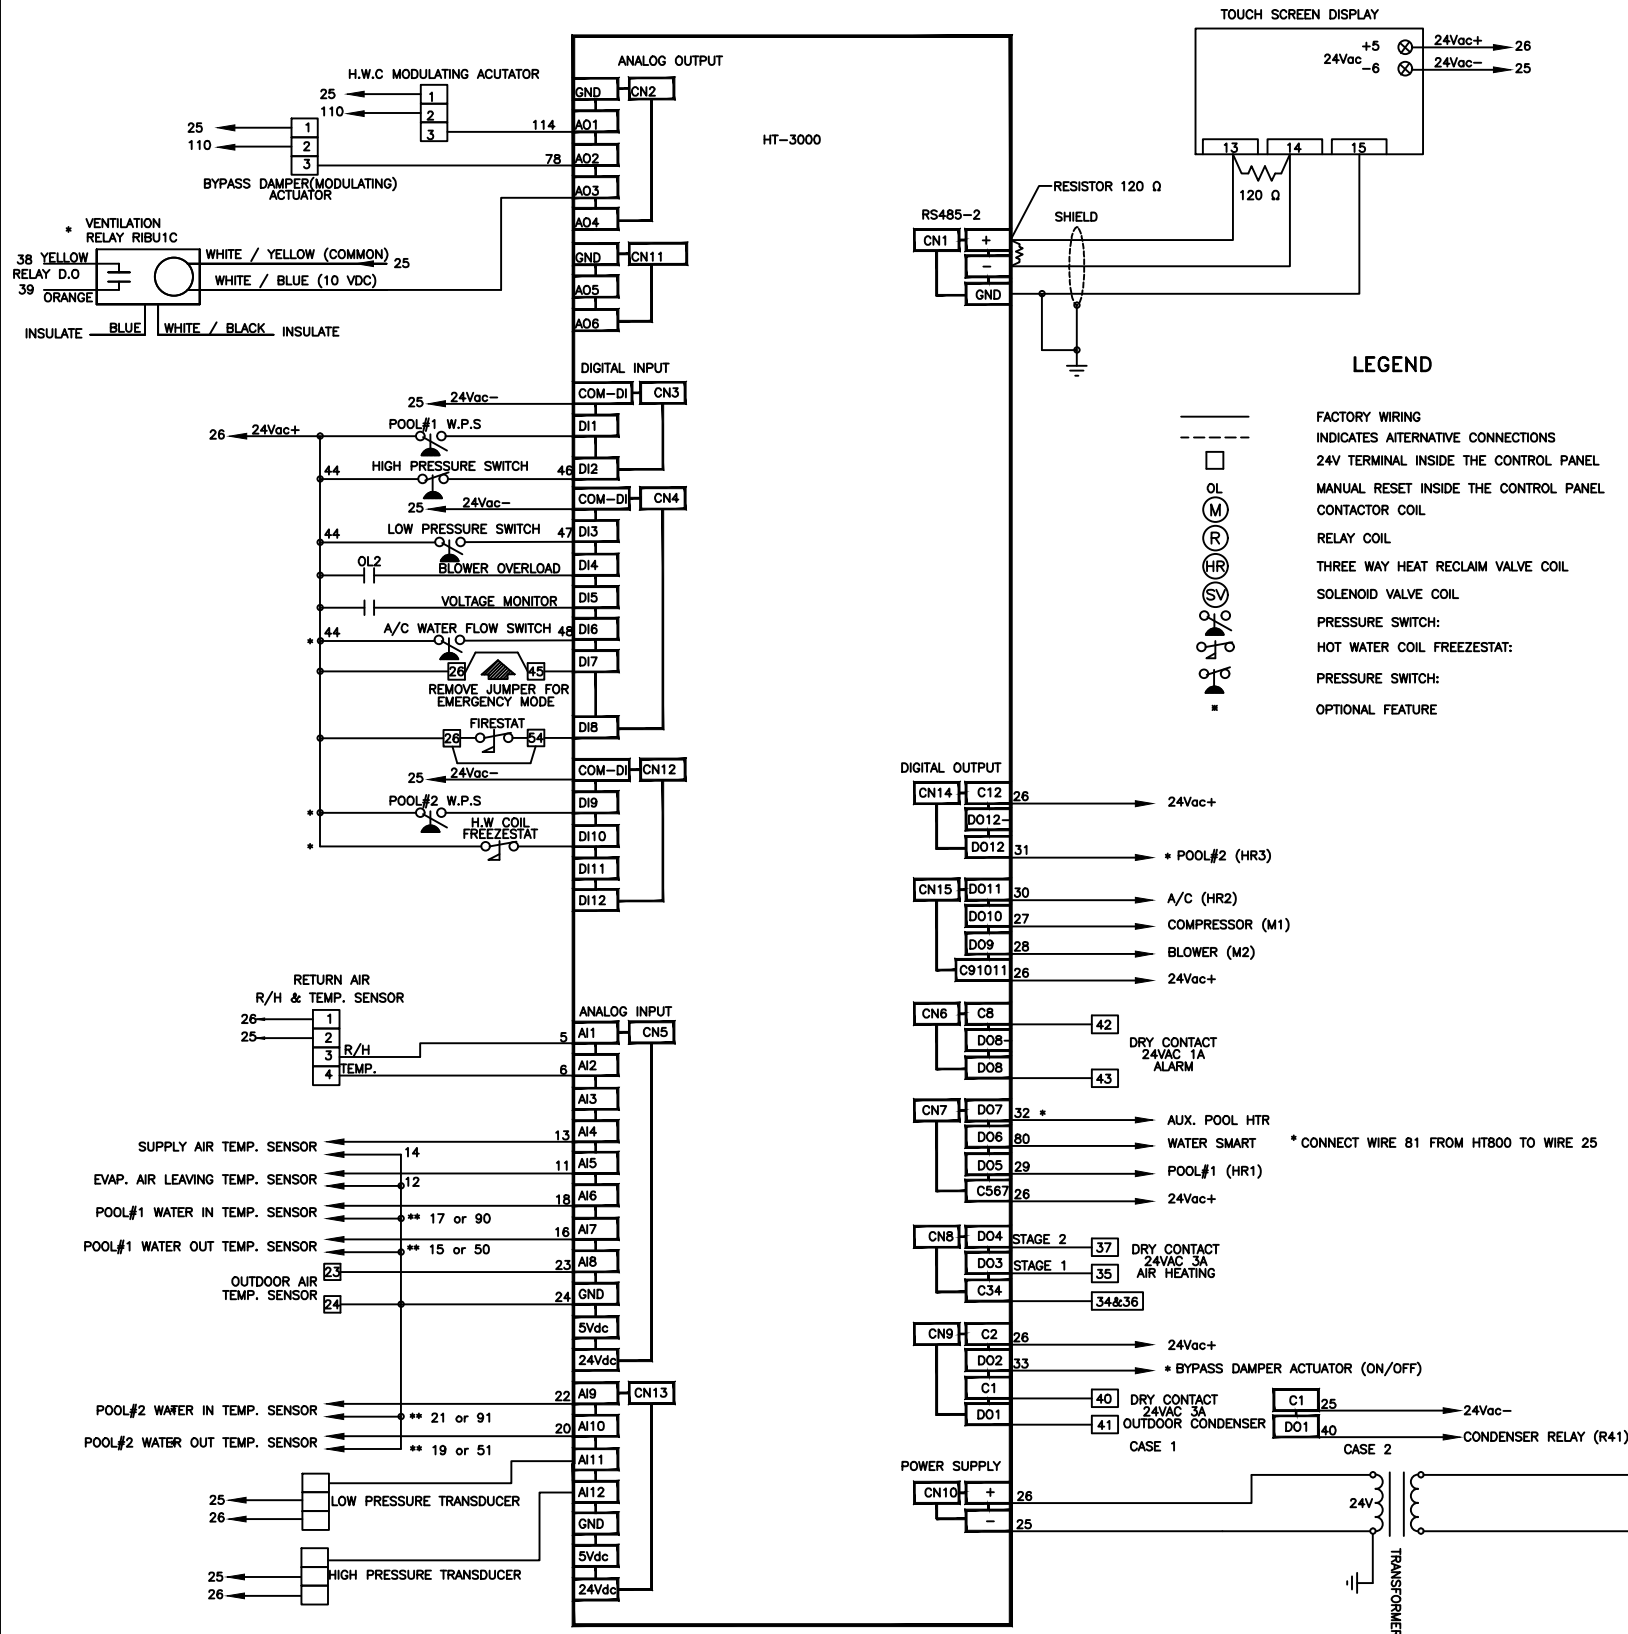

** REFER TO UNIT WIRING DIAGRAM FOR CORRECT WIRE NUMBER

NOTICE TO PERSONS RECEIVING THIS DRAWING AND/OR TECHNICAL INFORMATION							DRAWN: DESSINE PAR: JH		
Dehumidified Air Solutions Inc. claims proprietary rights to the material disclosed hereon. The drawing and/or technical information is issued in confidence for engineering information only and may not be reproduced or used to manufacture anything shown or referred to hereon without direct written permission from Dehumidified Air Solutions Inc. to the user. The drawing and/or technical information is the property of Dehumidified Air Solutions Inc. and is loaned for mutual assistance, to be returned when its purpose has been served.						CHECKED: VERIFIE PAR:	TITLE: HT3000 WIRING DIAGRAM (HT800 REPLACEMENT)		
							APPROVED: APPROUVE:		TITLE:
							SCALE: ECHELLE: NTS		
	3	9/30/19	GND SHIELD			REF:			
2	9/26/19	RESISTORS ON TOUCH SCREEN			REF. NO:				
THIS DRAWING AND/OR TECHNICAL INFORMATION IS THE PROPERTY OF DEHUMIDIFIED AIR SOLUTIONS INC.									
NO	DATE	REVISIONS			PAR: BY:	CHK	DATE: SEP-30-2019	DWG. NO: HT3000 25- & 26+ REV: 04 SHEET: 1 OF 1	